


Fire Extinguisher Bracket Mounting



- NOTE:
- FASTENERS MUST BE POSITIONED VERTICALLY ON THE CENTER LINE OF THE TRIM EXTRUSION
 - MAXIMUM FASTENER DIAMETER 1/4"
 - MINIMUM FASTENER LENGTH 1" PLUS BRACKET THICKNESS

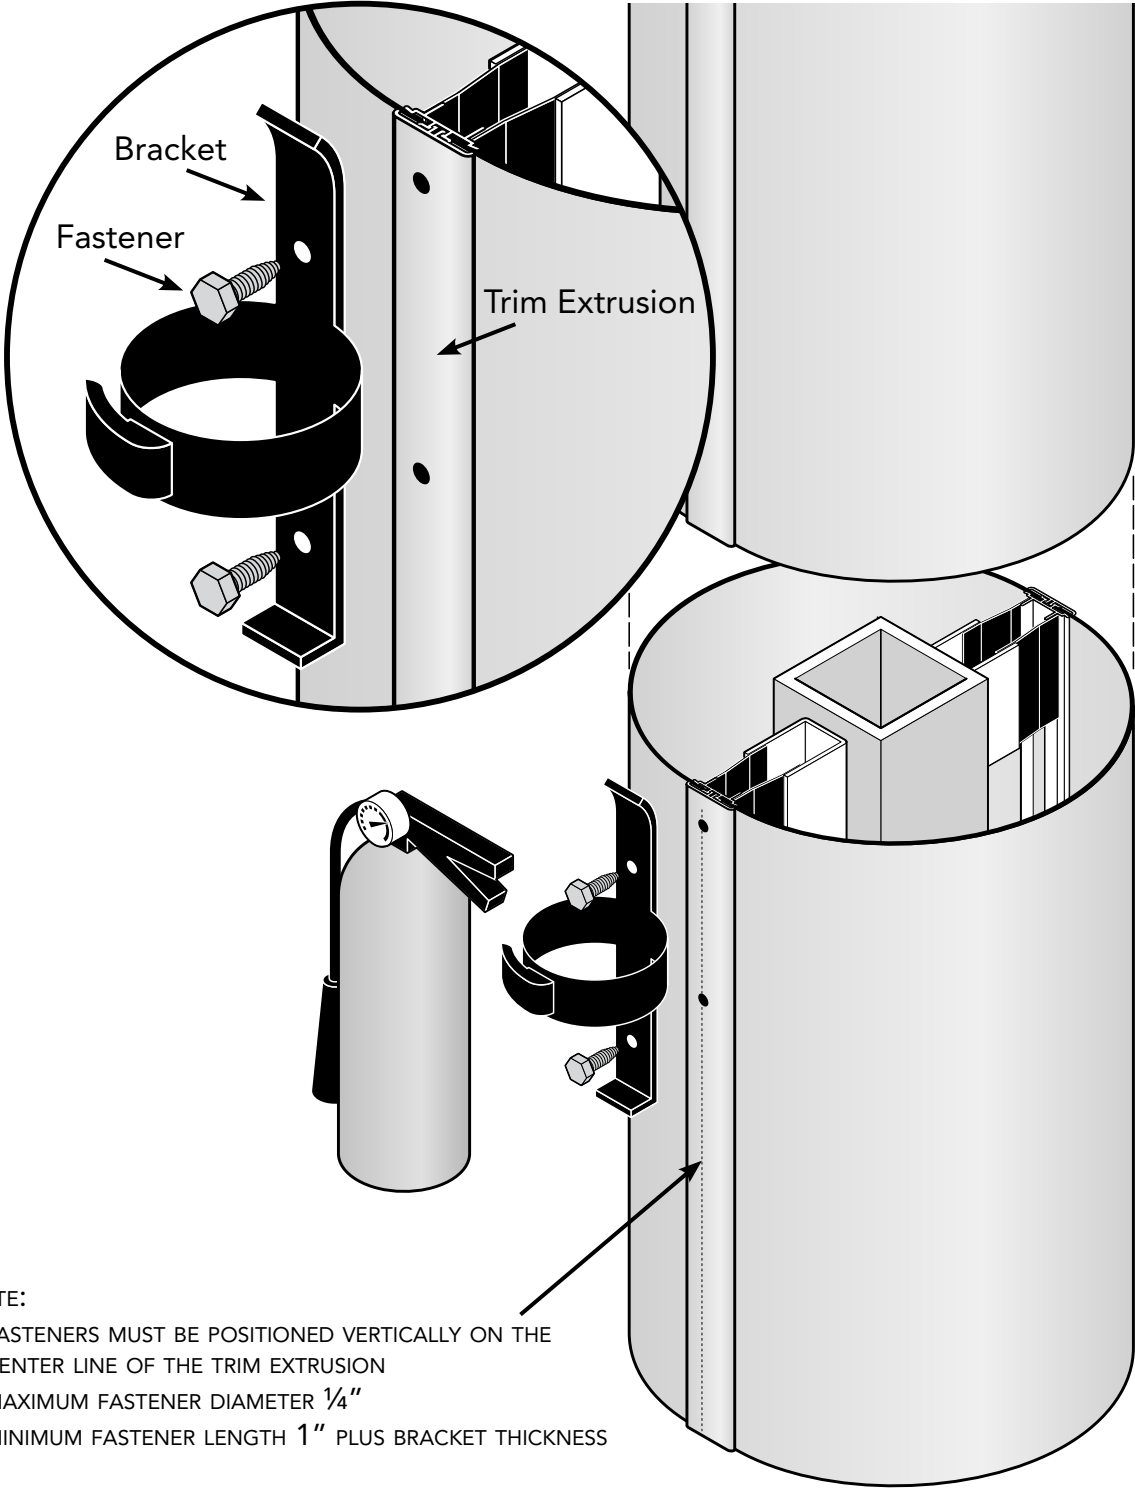

Questions? Call 800-228-8925